


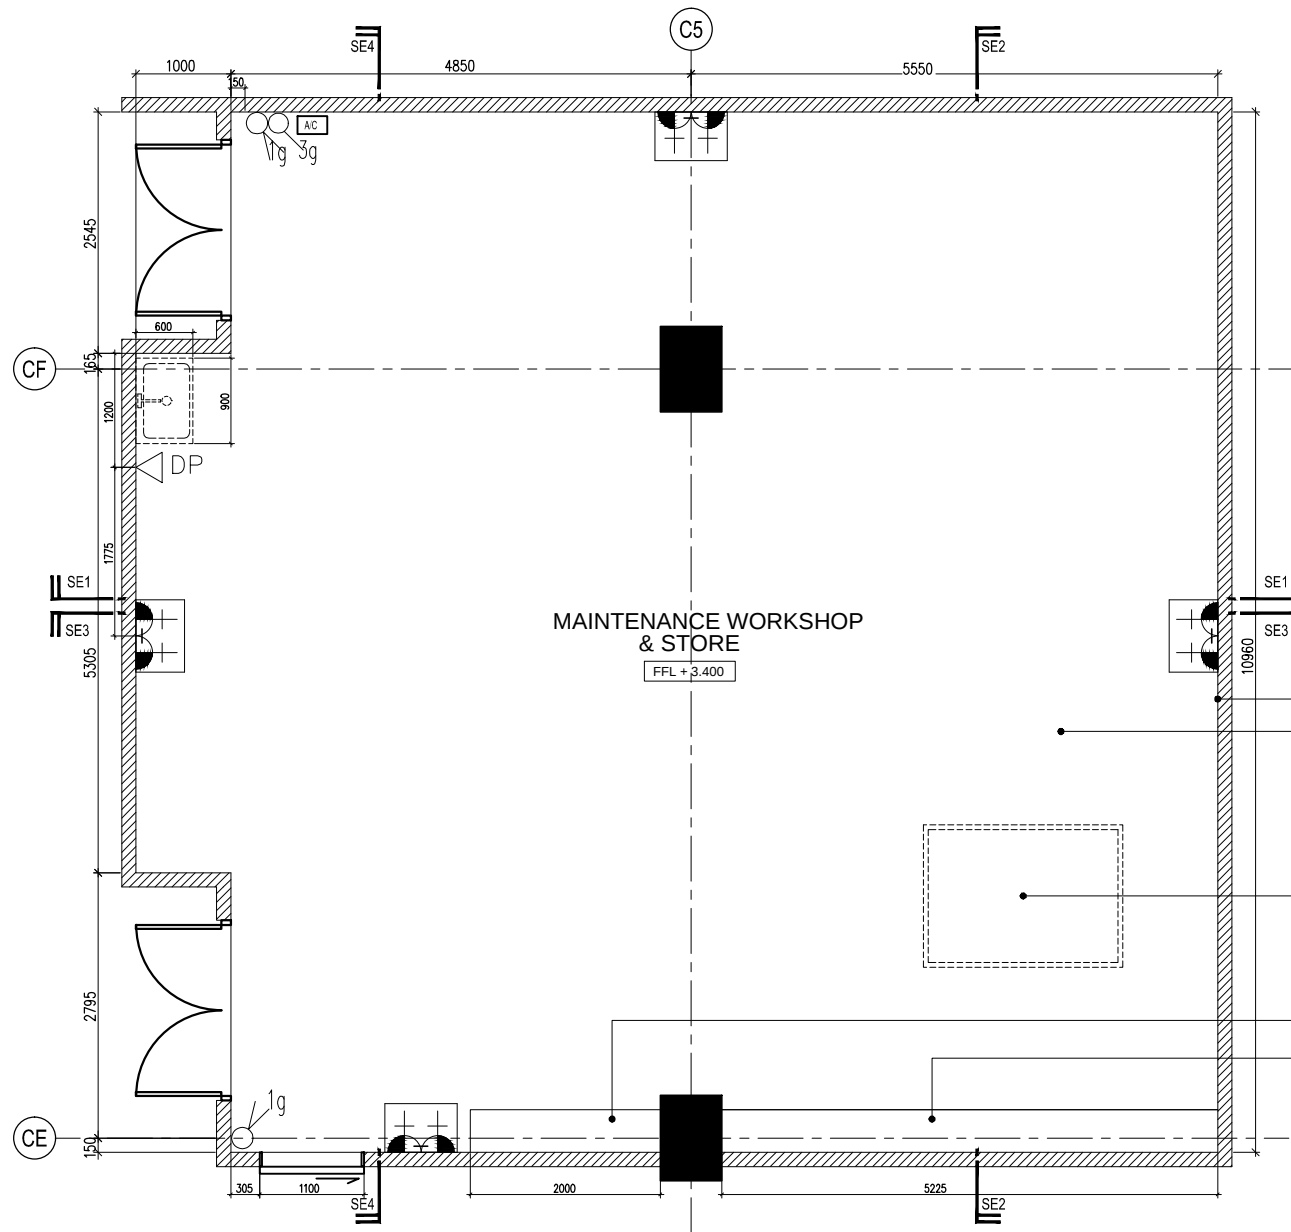

LEGEND ELECTRICAL INSTALLATION

SYMBOL	DESCRIPTION(S)	QTY
—	2 X 28W 15 BARE CHANNEL FLUO. LIGHT FTL. C/W ELECTRONIC BALLAST.	14
1/2/3/	10A 1/2/3/ GANG ONE WAY LIGHTING SWITCH AT 1450mm AFL.	—
1/2/3/4/5	10A 1/2/3/4/5 GANG TWO WAY LIGHTING SWITCH AT 1450mm AFL.	2
□	13A TWIN SWITCH SOCKET OUTLET (METAL CLAD TYPE) AT 1450mm AFL.	4

LEGEND FIRE INSTALLATION

SYMBOL	DESCRIPTION(S)	QTY
●	PENDENT SPRINKLER (155F/ABC TEMPERATURE RATING).	—
○	UPRIGHT SPRINKLER (155F/ABC TEMPERATURE RATING).	16
EL	EMERGENCY LIGHT, (SUPPLY & INSTALL BY ELECTRICAL CONTRACTOR)	1
△	9 KG5 ABC DRY POWDER PORTABLE FIRE EXTINGUISHER.	1

ARCH NOTE:

- 1) ALL WORKS SHALL BE CARRIED OUT UNDER THE MAIN CONTRACTOR UNLESS SPECIFIED OTHERWISE.
- 2) CONTRACTOR SHALL REFER CONCURRENTLY TO ARCHITECTURAL SCHEDULE OF FINISHES, WALL TYPE, CEILING TYPE, WINDOW, DOOR, FURNITURE AND SANITARYWARE.
- 3) CONTRACTOR SHALL REFER CONCURRENTLY TO M&E SCHEDULES FOR MECHANICAL, ELECTRICAL ACCESSORIES AND LIGHT FITTINGS.
- 4) CONTRACTOR SHALL SUBMIT COORDINATED SHOP DRAWINGS BASED ON APPROVED SITE DIMENSIONS FOR ARCHITECT'S APPROVAL.
- 5) CONTRACTOR SHALL SUBMIT ALL PROPOSED MATERIALS AND SAMPLES, FOR ARCHITECT'S APPROVAL.
- 6) ALL ID FITMENT, SYSTEM & LOOSE FURNITURE REFER TO ID SCHEDULE/DETAILS (BY ID CONTRACTOR).

M&E NOTE:

- 1) ALL EQUIPMENT DIMENSION SHOWN IS PRELIMINARY & ACTUAL DIMENSION TO BE DETERMINED BASED ON EQUIPMENT SELECTED.
- 2) 200 LIT LEVEL DESIGN BASED ON MS STANDARD:1525 (2007)
- 3) TO MEET MINIMUM REQUIREMENTS OF VENTILATION RATE IN ASHRAE 62.1 OR THE LOCAL BUILDING CODE WHICHEVER IS MORE STRINGENT.
- 4) THESE DRAWINGS SHALL BE STUDIED IN CONJUNCTION WITH ARCHITECTURAL, STRUCTURAL, MECHANICAL, ELECTRICAL & PLUMBING DRAWING.

- BRICKWALL WITH PLASTER AND PAINT FINISH
- FLOOR FINISHED REFER TO SCHEDULE WITH 100MM(H) TILE SKIRTING
- HEAVY DUTY WORK TABLE – DIM. 5'X7'X33"(H)
- 1800MM(H) METAL SWING DOOR FILING CABINET TO FURNITURE SCHEDULE (ID)
- 1800MM(H) HEAVY DUTY STORAGE RACKING TO FURNITURE SCHEDULE (ID)

CONSTRUCTION DRAWING

PROJECT TITLE :
CADANGAN MEMBINA SEBUAH KOLEJ UNIVERSITI SWASTA
DI ATAS PT 5828, PERSIARAN CASSIA BARAT 3, BATU KAWAN,
MK. 13, SEBERANG PERAI SELATAN YANG MENGANDUNGI :
BLOK A – PUSAT PENTADBIRAN 5 TINGKAT
BLOK B – PERPUSTAKAAN DAN BILIK KULIAH 6 TINGKAT
BLOK C – BANGUNAN AKADEMIK DAN DEWAN SERBAGUNA
B3 TINGKAT DENGAN PODIUM
BLOK D – DEWAN KULIAH DAN KAFETERIA 3 TINGKAT
BLOK E – BANGUNAN AKADEMIK 5 TINGKAT
2 UNIT PONDOK PENGAWAL DAN
1 UNIT TNB 11 KV STESEN SUIS UTAMA
UNTUK: TETUAN KDU COLLEGE (PG) SDN. BHD

LAND OWNER & BUILDING OWNER SIGNATURE :
.....
NAME : DR.CHONG BENG KEOK
CHIEF EXECUTIVE OFFICER (CEO)
IC. NO : 610612-02-5048
ALAMAT :KDU COLLEGE (PG) SDN.BHD.
32, JALAN ANSON, 10400 GEORGE TOWN,
PULAU PINANG.
TEL. NO : 604-2386368

DESIGN ARCHITECT :
ARCHITECTURE GROUP - STUDIO A
CPG CONSULTANTS PTE LTD
1 Gateway Drive #23-01
Westgate Tower, Singapore 608531
Tel : +63574888 ; fax: +63574188
BH YEW ARCHITECT
15TH FLOOR, BANGUNAN AMMETLIFE,
NO.1, JLN. LUMUT, 50400 KUALA LUMPUR.
TEL: (30)-4046-1346
FAX: (03) 4043-1349
EMAIL: ybhwa@nrasb.com.my
ARCHITECT SIGNATURE :
.....

C&S CONSULTANT :
PERUNDING KELANA
CIVIL & STRUCTURAL ENGINEERS
Level 12, Unit 12(D), Wisma Boon Siew,
No.1, Penang Road, 10000 Penang.
Tel: 2622628, Fax: 2641618
(Company No. A55232772-W)
M&E CONSULTANT :
PERUNDING P.L.A.
Consulting Mechanical & Electrical Engineers.
8-01, WISMA PANTAI,
JALAN WISMA PANTAI,
12200 BUTTERWORTH, PENANG.
TEL. NO. : (604) 3337990
FAX NO. : (604) 3317337
E-MAIL : project@pla-group.com

QS CONSULTANT :
UNITECH QS CONSULTANCY SDN. BHD.
12A-A, MENARA NORTHAM,
55, JALAN SULTAN AHMAD SHAH,
10050 PENANG
KITCHEN SPECIALIST :
DISHES SDN BHD
NO. 21-1, JALAN SEMENYIH SENTRAL 1,
SEMENYIH SENTRAL,
SEMENYIH, 43500 SELANGOR
TEL. : +603-872-71201
email : info@dishes.com.my
webmail : www.dishes.com.my

DRAWING TITLE :
BLOCK C_GROUND FLOOR
MAINTENANCE WORKSHOP &
STORE
FURNITURE LAYOUT PLAN
DATE : 21.03.16
SCALE : 1:75
CHECK BY : EJ/EDM
PROJECT NO. : 55314
STATUS : CA
BLOCK : C
DWG. NO : G501
REVISION : A