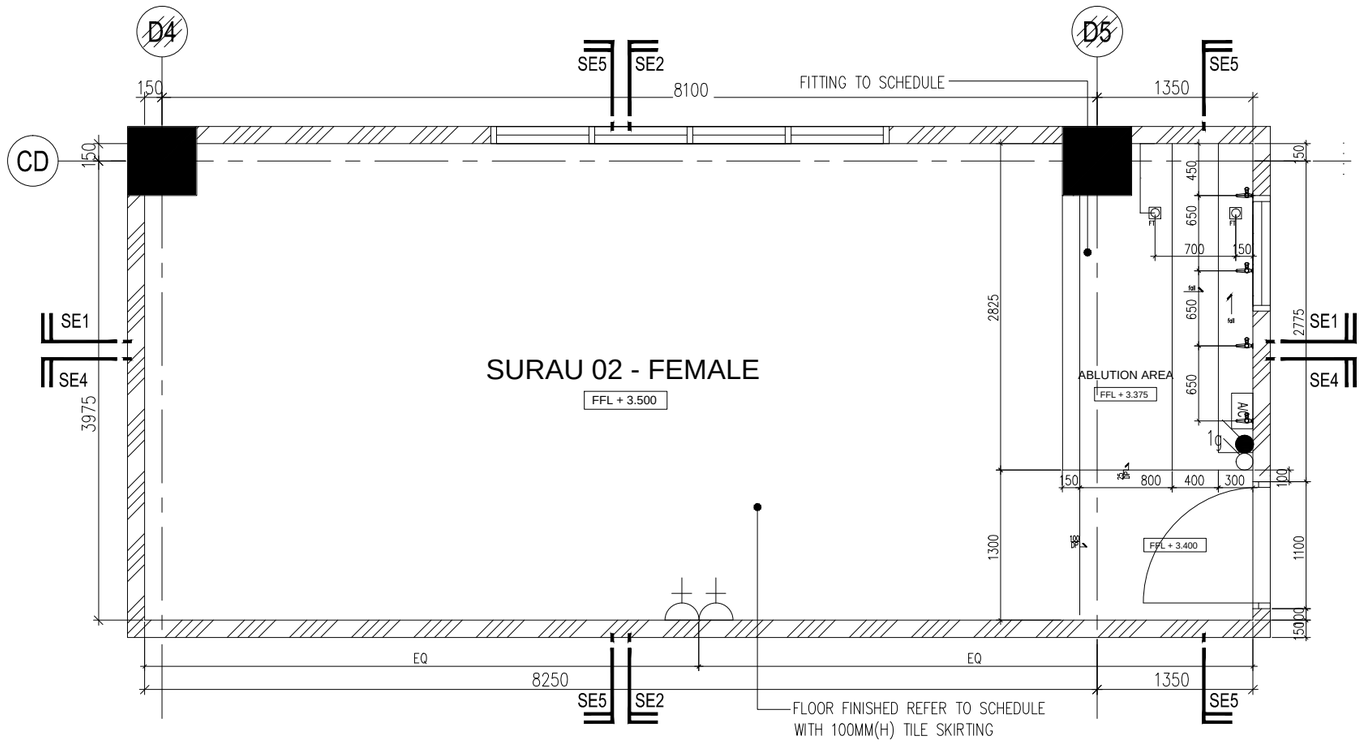

LEGEND : ELECTRICAL INSTALLATION

SYMBOL	DESCRIPTION(S)	QTY
	1 X 28W T5 SURFACE MOUNTED TYPE BARE CHANNEL FLUO. LIGHT FTG. (ELECTRONIC BALLAST).	3
	10A 1/2/3/ GANG ONE WAY LIGHTING SWITCH AT 1450mm AFFL.	1 – –
	13A SWITCH SOCKET OUTLET AT 305mm AFFL.	2
EL	EMERGENCY LIGHT. (SUPPLY & INSTALL BY ELECTRICAL CONTRACTOR)	1
	20A 1 GANG ONE WAY DOUBLE POLE SWITCH FOR A/C AT 1450mm AFFL.	1

LEGEND : FIRE INSTALLATION

SYMBOL	DESCRIPTION(S)	QTY
	PENDENT SPRINKLER (155°F/68°C TEMPERATURE RATING).	7
	UPRIGHT SPRINKLER (155°F/68°C TEMPERATURE RATING).	10
EL	EMERGENCY LIGHT. (SUPPLY & INSTALL BY ELECTRICAL CONTRACTOR)	1

ARCHI NOTE:
1) ALL WORKS SHALL BE CA IED OUT UNDER THE MAIN CONTRACTOR UNLESS SPECIFIED OTHERWISE.
2) CONTRACTOR SHALL REFER CONCU ENTLY TO ARCHITECTURAL SCHEDULE OF FINISHES, WALL TYPE, CEILING TYPE, WINDOW, DOOR, IRONMONGERY AND SANITARYWARE.
3) CONTRACTOR SHALL REFER CONCU ENTLY TO M&E SCHEDULES FOR MECHANICAL, ELECTRICAL ACCESSORIES AND LIGHT FITTINGS.
4) CONTRACTOR SHALL SUBMIT COORDINATED SHOP DRAWINGS BASED ON VERIFIED SITE DIMENSIONS, FOR ARCHITECT'S APPROVAL.
5) CONTRACTOR SHALL SUBMIT ALL PROPOSED MATERIALS AND SAMPLES, FOR ARCHITECT'S APPROVAL.

M&E NOTE:
1) ALL EQUIPMENT DIMENSION SHOWN IS PRELIMINARY & ACTUAL DIMENSION TO BE DETERMINED BASED ON EQUIPMENT SELECTED.
2) 300 LUX LEVEL DESIGN BASED ON MS STANDARD:1525 (2007)
3) TO MEET MINIMUM REQUIREMENTS OF VENTILATION RATE IN ASHRAE 62.1 OR THE LOCAL BUILDING CODE WHICHEVER IS MORE STRINGENT.
4) THESE DRAWINGS SHALL BE STUDIED IN CONJUNCTION WITH ARCHITECTURAL, STRUCTURAL, MECHANICAL, ELECTRICAL & PLUMBING DRAWING.

CONSTRUCTION DRAWING

PROJECT TITLE :
CADANGAN MEMBINA SEBUAH KOLEJ UNIVERSITI SWASTA DI ATAS PT 5828, PERSIARAN CASSIA BARAT 3, BATU KAWAN, MK. 13, SEBERANG PERAI SELATAN YANG MENGANDUNGI :
BLOK A – PUSAT PENTADBIRAN 5 TINGKAT
BLOK B – PERPUSTAKAAN DAN BILIK KULIAH 6 TINGKAT
BLOK C – BANGUNAN AKADEMIK DAN DEWAN SERBAGUNA B3 TINGKAT DENGAN PODIUM
BLOK D – DEWAN KULIAH DAN KAFETERIA 3 TINGKAT
BLOK E – BANGUNAN AKADEMIK 5 TINGKAT
2 UNIT PONDOK PENGAWAL DAN
1 UNIT TNB 11 KV STESEN SUIS UTAMA
UNTUK: TETUAN KDU COLLEGE (PG) SDN. BHD

LAND OWNER & BUILDING OWNER SIGNATURE :
.....
NAME : DR.CHONG BENG KEOK
CHIEF EXECUTIVE OFFICER (CEO)
IC. NO : 610612-02-5048
ALAMAT : KDU COLLEGE (PG) SDN.BHD.
32, JALAN ANSON, 10400 GEORGE TOWN,
PULAU PINANG.
TEL. NO : 604-2386368

DESIGN ARCHITECT :
ARCHITECTURE GROUP - STUDIO A
CPG CONSULTANTS PTE LTD
1 Gateway Drive #23-01
Westgate Tower, Singapore 608531
Tel : +63574888 ; fax: +63574188

BH YEW ARCHITECT
15TH FLOOR, BANGUNAN AMMETLIFE,
NO.1, JLN. LUMUT, 50400 KUALA LUMPUR.
TEL: (30)-4046-1346
FAX: (03) 4043-1349
EMAIL: ybhwo@hrasb.com.my

ARCHITECT SIGNATURE :
.....

C&S CONSULANT :
PERUNDING KELANA
CIVIL & STRUCTURAL ENGINEERS
Level 12, Unit 12(D), Wisma Boon Siew,
No.1, Penang Road, 10000 Penang.
Tel: 2622628, Fax: 2641618
(Company No. AS0232772-W)

M&E CONSULANT :
PERUNDING P.L.A.
Consulting Mechanical & Electrical Engineers.
8-01, WISMA PANTAI,
JALAN WISMA PANTAI,
12200 BUTTERWORTH, PENANG.
TEL. NO. : (604) 3337990
FAX NO. : (604) 3317337
E-MAIL : project@pla-group.com

QS CONSULANT :
UNITECH QS CONSULTANCY SDN. BHD.
12A-A, MENARA NORTHAM,
55, JALAN SULTAN AHMAD SHAH,
10050 PENANG

KITCHEN SPECIALIST :
DiSHES SDN BHD
NO. 21-1, JALAN SEMENYIH SENTRAL 1,
SEMENYIH SENTRAL,
SEMENYIH, 43500 SELANGOR
TEL : +603-872-71201
email : info@dishes.com.my
webmail : www.dishes.com.my

DRAWING TITLE :
BLOCK D_GROUND FLOOR
SURAU 02 – FEMALE
FURNITURE LAYOUT PLAN

DATE :	SCALE :	CHECK BY :
18.03.16	1:50	EJ/EDM

PROJECT NO. :	STATUS	BLOCK	DWG. NO	REVISION
55314	CA	D	L101	A