


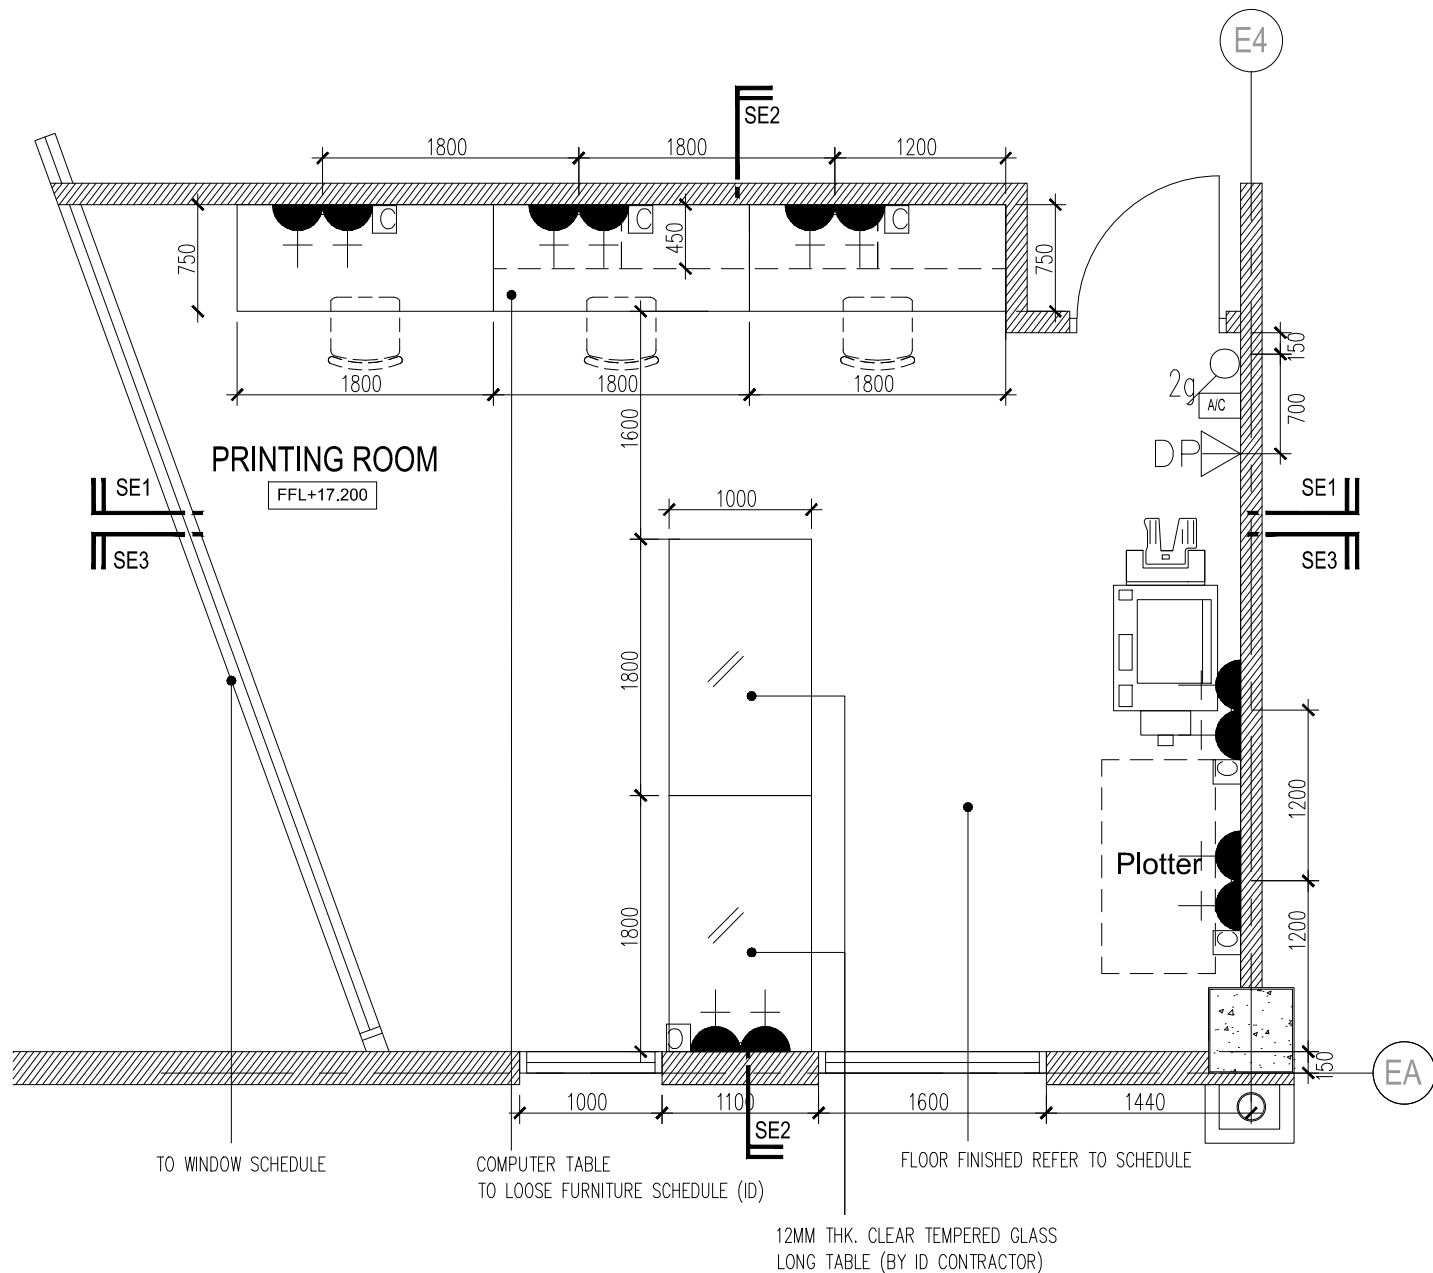

LEGEND : ELECTRICAL INSTALLATION

SYMBOL	DESCRIPTION(S)	QTY
	2 X 28W RECESSED TYPE T5 FLUO. FTG. C/W MIRROR REFLECTOR & ALUMINIUM CROSS BLADE (ELECTRONIC BALLAST)	5
	10A 1/2/3/ GANG ONE WAY LIGHTING SWITCH AT 1450mm AFFL.	1
	13A TWIN SWITCH SOCKET OUTLET AT 1000MM AFFL. (UNLESS OTHERWISE STATED)	6
	25MM PVC CONDUIT FOR AUDIO AND VISUAL C/W INSPECTION BOX (BY ELECTRICAL CONTRACTOR)	AS SHOWN

LEGEND : FIRE INSTALLATION

SYMBOL	DESCRIPTION(S)	QTY
	PENDENT SPRINKLER (155F/68°C TEMPERATURE RATING).	6
	UPRIGHT SPRINKLER (155F/68°C TEMPERATURE RATING).	5
	EMERGENCY LIGHT. (SUPPLY & INSTALL BY ELECTRICAL CONTRACTOR)	1
	9 KGS ABC DRY POWDER PORTABLE FIRE EXTINGUISHER.	1

ARCH. NOTE:
1) ALL WORKS SHALL BE CARRIED OUT UNDER THE MAIN CONTRACTOR UNLESS SPECIFIED OTHERWISE.
2) CONTRACTOR SHALL REFER CONCURRENTLY TO ARCHITECTURAL SCHEDULE OF FINISHES, WALL TYPE, CEILING TYPE, WINDOW, DOOR, IRONMONGERY AND SANITARYWARE.
3) CONTRACTOR SHALL REFER CONCURRENTLY TO MAE SCHEDULES FOR MECHANICAL, ELECTRICAL ACCESSORIES AND LIGHT FITTINGS.
4) CONTRACTOR SHALL SUBMIT COORDINATED SHOP DRAWINGS BASED ON VERIFIED SITE DIMENSIONS, FOR ARCHITECT'S APPROVAL.
5) CONTRACTOR SHALL SUBMIT ALL PROPOSED MATERIALS AND SAMPLES, FOR ARCHITECT'S APPROVAL.
6) SYSTEM FURNITURE & LOOSE FURNITURE REFER TO SCHEDULE (ID)

MAE NOTE:
1) ALL EQUIPMENT DIMENSION SHOWN IS PRELIMINARY & ACTUAL DIMENSION TO BE DETERMINED BASED ON EQUIPMENT SELECTED.
2) 300 LUX LEVEL DESIGN BASED ON MS STANDARD:1525 (2007)
3) TO MEET MINIMUM REQUIREMENTS OF VENTILATION RATE IN ASHRAE 62.1 OR THE LOCAL BUILDING CODE WHICHEVER IS MORE STRINGENT.
4) THIS DRAWING SHALL BE STUDIED IN CONJUNCTION WITH ARCHITECTURAL, STRUCTURAL, MECHANICAL, ELECTRICAL & PLUMBING DRAWING.
5) CEILING HEIGHT SHALL ACHIEVE 2800MM MINIMUM.
6) JUNCTION BOX & UNDERFLOOR TRUNKING/ CONCEALED CONDUIT/TRUNKING SHALL BE PROVIDED BY ELECTRICAL CONTRACTOR FOR AUDIO/VISUAL SERVICES TO LECTURER SEATING AREA.

CONSTRUCTION DRAWING

PROJECT TITLE :
CADANGAN MEMBINA SEBUAH KOLEJ UNIVERSITI SWASTA DI ATAS PT 5828, PERSIARAN CASSIA BARAT 3, BATU KAWAN, MK. 13, SEBERANG PERAI SELATAN YANG MENGANDUNGI :
BLOK A – PUSAT PENTADBIRAN 5 TINGKAT
BLOK B – PERPUSTAKAAN DAN BILIK KULIAH 6 TINGKAT
BLOK C – BANGUNAN AKADEMIK DAN DEWAN SERBAGUNA B3 TINGKAT DENGAN PODIUM
BLOK D – DEWAN KULIAH DAN KAFETERIA 3 TINGKAT
BLOK E – BANGUNAN AKADEMIK 5 TINGKAT
2 UNIT PONDOK PENGAWAL DAN
1 UNIT TNB 11 KV STESEN SUIS UTAMA
UNTUK: TETUAN KDU COLLEGE (PG) SDN. BHD

LAND OWNER & BUILDING OWNER SIGNATURE :

NAME : DR.CHONG BENG KEOK
CHIEF EXECUTIVE OFFICER (CEO)
IC. NO : 610612-02-5048
ALAMAT :KDU COLLEGE (PG) SDN.BHD.
32, JALAN ANSON, 10400 GEORGE TOWN,
PULAU PINANG.
TEL. NO : 604-2386368

DESIGN ARCHITECT :
ARCHITECTURE GROUP - STUDIO A
CPG CONSULTANTS PTE LTD
1 Gateway Drive #23-01
Westgate Tower, Singapore 608531
Tel : +63574888 ; fax: +63574188
ARCHITECT SIGNATURE :
BH YEOW ARCHITECT
15TH FLOOR, BANGUNAN AMMELIFE,
NO.1, JLN. LUMUT, 50400 KUALA LUMPUR.
TEL: (30)-4046-1346
FAX: (03) 4043-1349
EMAIL: ybhwa@nrasb.com.my

C&S CONSULTANT :
PERUNDING KELANA
CIVIL & STRUCTURAL ENGINEERS
Level 12, Unit 12(D), Wisma Boon Siew,
No.1, Penang Road, 10000 Penang.
Tel: 2622628, Fax: 2641618
(Company No. A50232772-W)
M&E CONSULTANT :
PERUNDING P.L.A.
Consulting Mechanical & Electrical Engineers.
8-01, WISMA PANTAI,
JALAN WISMA PANTAI,
12200 BUTTERWORTH, PENANG.
TEL. NO. : (604) 3337990
FAX NO. : (604) 3317337
E-MAIL : project@pla-group.com

QS CONSULTANT :
UNITECH QS CONSULTANCY SDN. BHD.
12A-A, MENARA NORTHAM,
55, JALAN SULTAN AHMAD SHAH,
10050 PENANG
KITCHEN SPECIALIST :
DISHES SDN BHD
NO. 21-1, JALAN SEMENYIH SENTRAL 1,
SEMENYIH SENTRAL,
SEMENYIH, 43500 SELANGOR
TEL. : +603-872-71201
email : info@dishes.com.my
webmail : www.dishes.com.my

DRAWING TITLE :
BLOCK E_3RD FLOOR
PRINTING ROOM
FURNITURE LAYOUT PLAN

DATE : 09.05.16	SCALE : 1:50	CHECK BY : EJ/EDM			
PROJECT NO. : 55314		STATUS CA	BLOCK E	DWG. NO U001	REVISION A